


# 794-ЭР-0а1

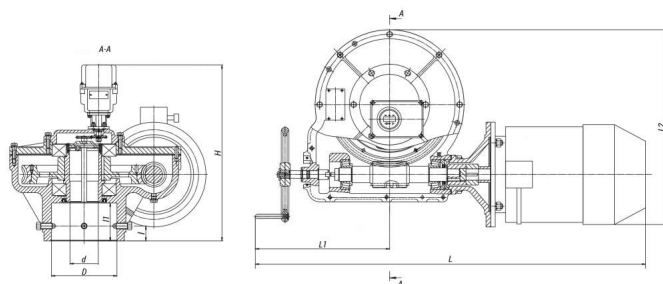

Production according to TR  
28.14.20-006-15365247-2016

**The built-in electric actuators of series: 825, 876, 854, 792, 793, 794, 795, 797, 768, 798 are intended for the control of isolation and control fittings of TPS.**

**The electric actuators enable the following actions:**

- Closing, opening and stopping in any intermediate position of a locking device of fittings from the control board and in manual mode.
- Automatic switching-off of the electric motor:
  - when the locking or control device achieves the established boundary positions;
  - in extreme positions and in the intermediate position at the moment of stroke of the gate element when achieving the rotational torque on the driving shaft higher than the set one.
- Local and remote indication of the locking device position.
- Electric blocking of the electric motor in case of manual control of the fittings.
- Remote signaling.

## Specifications

| Applicability to Fittings | Maximum Torque on the Output Shaft of the Electric Actuator at ПБ =15% , N·m | Nominal Torque on the Output Shaft of the Electric Actuator at ПБ =25% , N·m | Rotational Speed, rpm | Power, kW | DN, mm | d, mm | L, mm | L1, mm | l, mm | l1, mm | b, mm | d+t, mm | Motor Model   | H, mm | D, mm | H1, mm | Weight without Electric Actuator, kg | Torque, N·m |
|---------------------------|--|--|-----------------------|-----------|--------|-------|-------|--------|-------|--------|-------|---------|---------------|-------|-------|--------|--------------------------------------|-------------|
| Control                   | 0  | 560  | 41,2                  | 3,2       | 0      | 85    | 955   | 550    | 25    | 87     | 18    | 89,4    | AMPC 100S 4Y3 | 430   | 185   | 355    | 110,8                                | 0           |

**The electric actuators for gate valves** are designed for operation in a short-time mode, the frequency of starting per an hour is not more than 6 times with the cyclic duration factor (CDF) of not more than 15%. The turning-off of the electric actuators happens in case of complete closing/opening of gate valves, i.e. when the overcurrent relay is activated.

**The electric actuators for the control valves** are designed for operation in an intermittent revertive operation mode with the number of switchings up to 320 per hour and the cyclic duration factor (CDF) up to 25% in case when the load on the output shaft is equal to the nominal one. At the same time, the electric actuators shall enable operation within 1 hour in an intermittent revertive operation mode with the number of switchings up to 630 per hour and CDF up to 25% with subsequent repetition not more than in 3 hours.

**Page link:**

<https://en.bkzn.ru/catalog/elektroprivody-ooo-bkz/vstroennye-elektroprivody/794-er-0ai/>